

UDC

CJJ

P

—

---

# 二次供水工程技术规程

Technical specification for secondary water supply engineering





## 目 次

1	1
2	2
3	3
4	4
5	5
5.1	5
5.2	5
5.3	5
5.4	5
6	7
6.1	7
6.2	7
6.3	8
6.4	8
6.5	9
7	10
8	11
8.1	11
8.2	11
9	12
9.1	12
9.2	12
9.3	12
10	13
10.1	13
10.2	13
11	15
11.1	15
11.2	15
11.3	15

17  
18  
19

## contents

1	General provisions	1
2	Terms	2
3	Basic requirements	3
4	Water quality water quantity hydraulic pressure	4
5	System design	5
5.1	General requirement	5
5.2	System selection	5
5.3	Flow and pressure	5
5.4	Pipeline layout	5
6	Device and facility	7
6.1	Cistern(water tank)	7
6.2	Pressure vessel	7
6.3	Water pump	8
6.4	Pipeline accessory	8
6.5	Disinfection device	9
7	Pump room	10
8	Control and protection	11
8.1	Control	(11)
8.2	Protection	11
9	Construction	12
9.1	General requirement	12
9.2	Equipment installation	12
9.3	Pipeline laying	12
10	Debugging and acceptance	13
10.1	Debugging	13
10.2	Acceptance	13
11	Operation maintenance and management	(15)
11.1	General requirement	15
11.2	Facility maintenance	15
11.3	Operation management	15
	Explanation of wording in this specification	17
	List of quoted standards	18
	Addition: Explanation of provisions	19



secondary water supply

secondary water supply installation

additive pressure water supply

service pipe, inlet pipe



GB50015

GB50013

GB/T50331

1  
2  
3  
4

GB50015

8 12

GB50015

7000


5

GB50013

GB50015

GB50015

GB50015

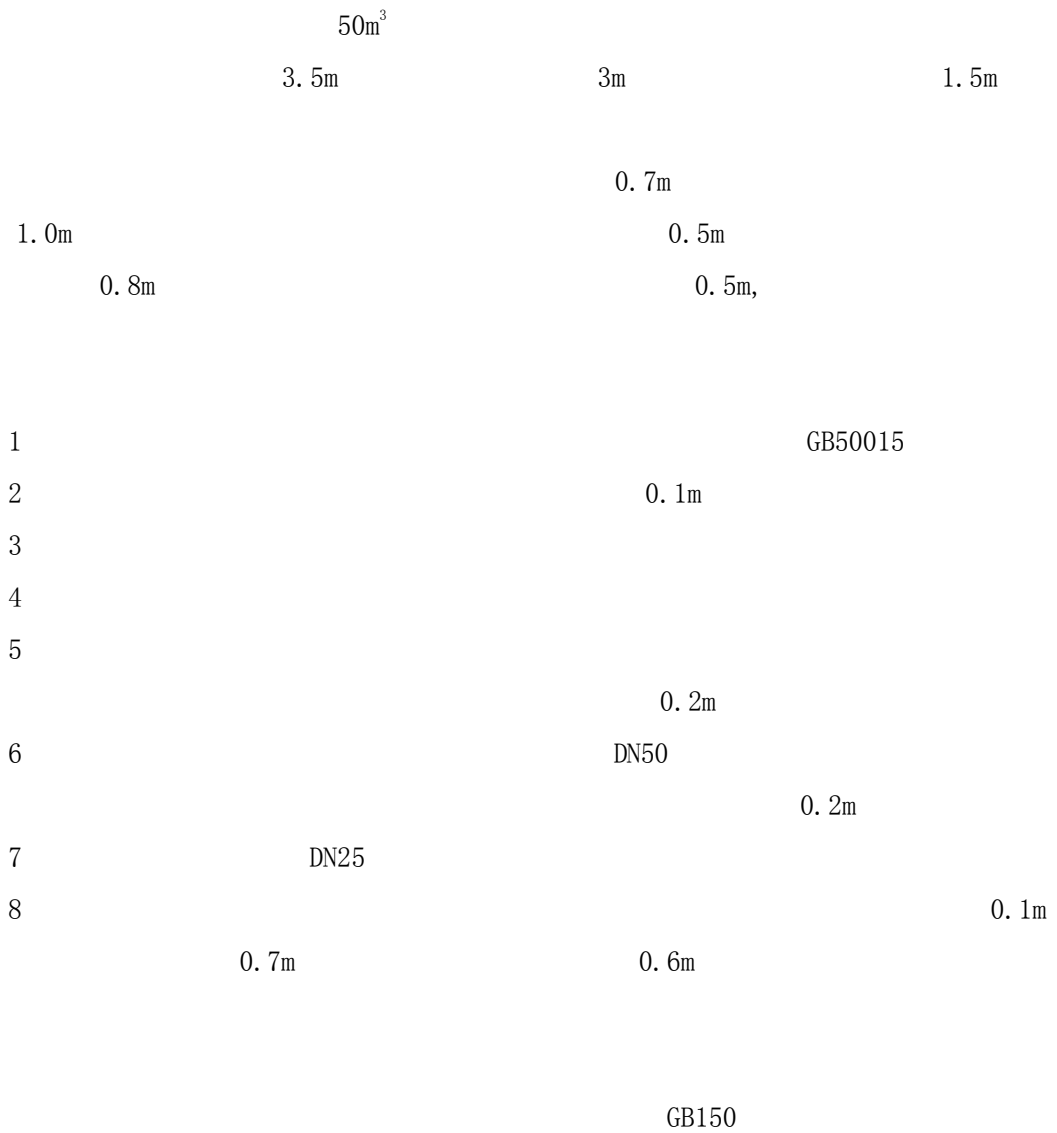

JB/T8098-1999 B  
JB/T8097-1999 B

JB/T8098-1999 C  
JB/T8097-1999 C

- 1
- 2
- 3
- 4

11kW

- 1
- 2

3

4

1

2

3

4

GB50015

20 40

1

2

GB50015

GB/T50265

1

2

3

4

GB50015

GB3096

GBJ118

0.01

0.1m

GB50015

11kW

65mm

0.8m

0.4m

1  
2  
3  
4

GB50055

,

1.5 2

JG/T3009

( )

GB/T3797

,

GB50275

GB50303

GB50242

0.003

1.0m

1.0m

0.8m

0.1m

24h

1.5 GB50242  
0.6MPa

30min

1.5m/s  
20mg/L 30mg/L

24h

GB5749

1  
GB50242

GB50300

2

GB50231

3

GB50303

1

2

3  
4  
5  
6  
7  
8

1  
2  
3  
4  
5  
6  
7  
8  
9

1  
2  
3



pH

1

1

2

3

4

2

1. GBJ118
2. GB50013
3. GB50015
4. GB50055
5. GB50231
6. GB50242
7. GB/T50265
8. GB50275
9. GB50300
10. GB50303
11. GB150
12. GB3096
13. GB/T3797
14. GB5749
15. GB/T17219
16. JG/T3009
17. JB/T8097-1999
18. JB/T8098-1999



CJJ140-20XX

20XX XX XX

XX

1

2

3

4

## 目 次

1	23
3	24
4	26
5	27
5.1	27
5.2	27
5.3	28
5.4	30
6	31
6.1	31
6.2	31
6.3	31
6.4	32
6.5	32
7	34
8	35
8.1	35
9	36
9.1	36
9.2	36
9.3	37
10	38
10.1	38
10.2	38
11	39
11.1	39
11.2	39
11.3	39



1

2

159

93

GB50015-2003 3.2.9



GB5749

GB50015

GB50015

GB50015-2003 3. 1. 14

1

2

1

2

3

4

5

6

CJJ92-2002

12%

( )

1

1) ( ) , ( ) ,

2) ( )

3)

24

2

1)

2)

3)

$$Q_L = Q_{d1} / T$$

$Q_L$	-	$m^3/h$	
$Q_{d1}$	-		$m^3/d$
$T$	-	$h$	

4)

3

1)

2)

4

$$H = H_1 + H_2 + 0.01H_3$$

$H$	-	$m$	
$H_1$	-		$m$
$H_2$	-	$m$	
$H_3$	-		$MPa$

5

$$H = H_{11} + H_{22} + V^2 / 2g$$

$H$	-	$m$	
$H_{11}$	-		$m$
$H_{22}$	-		$m$
$V$	-	$m/s$	

6

$$Z_x = Z_b + H_x + 0.01H_3$$

$Z_x$	-	$m$	
$Z_b$	-	$m$	

H<sub>x</sub> - ( ) m

H<sub>3</sub> - MPa

,

,

		GB50180-93	7000	15000
	2002		GB50180	
10000	15000	7000		
		7000		
		GB50015	GB50013	
GB50289				

$50\text{m}^3$   
 $50\text{m}^3$

1.0m 1.0m 1.0m 0.5m

1.5m

, 4

5

0.2m

7

2 3

3

7.0.11

GB50015

3



1

2 3

1

2

3

4

5

GB50015

1

2

3

279

159

128

GB50268

GB50231

GB50303

GB/T17219

10%

1.5

1.1

1

1

DN mm	S		

50	15	15	15
65 200	30	15	60
250 450	60	30	180

GB50275

6

CECS125 2001

CECS153 2003

CECS171 2004

CECS41 2004

PVC-C

CECS136:2007

GB5749



